

# MODEL F/S-3V-I & F/S-3V-3-I

#### Combination Fire/Smoke Damper

UL 555 and ULC S112 Listed for 1-1/2 and 3 Hour Rated UL 555S and ULC S112.1 Listed Class I Leakage

UL File No. R25410

#### Standard Construction: Frame: Roll formed galvanized steel hat-section with staked corners and integral bracing. Blades: 16 ga. roll formed galvanized steel. Minimum width: 4.25" (108 mm) Maximum width: 7.25" (184 mm) Bearings: Bronze Oilite, press-fit into frame. Axles: Square, plated steel. Seals: Pressure sensitive 450°F silicone blade edge seals and flexible metal jamb seals. Linkage: Concealed in frame. Linkage bars are .125" (3.2 mm) thick plated steel. Controlled Closure Device: (Heat Activated) EFL - 165°F Standard, 212°F, 250°F, 350°F available PFL - 165°F Standard, 212°F available Due to space limitations, Dampers below 12" tall with no sleeve and actuators in the airstream will be equipped with a spring/fuselink assembly in lieu of the EFL temperature response device. Finish: Mill galvanized. Actuator: UL Approved, See Actuator Page, depends on damper size and temperature rating, External or Internal Mounted. Maximum Velocity: 2000 fpm (10.2 m/s) on all sizes. um based on 5" wall or Floor Maximum Pressure: 4" w.g. (1kPa) Minimum Size: 6"w x 6"h (203mm x 152mm)(Ext, Actuator) U.L. 555S Classified at 250°F Minimum Size: 10"w x 14"h (254mm x 356mm)(Int. Actuator) or 350°F depending upon Max: - Single Section: 36"w x 48"h (914mm x 1219mm) Actuator/Operator Max. - 1-1/2 hr. Vertical: 108"w x 96"h (2743mm x 2438mm) Actuator/Operator Schedule Max. - 1-1/2 hr. Horizontal: 144"w x 96"h (3658mm x 2438mm)\* Max. - 3 hr. Vertical: 72"w x 48"h (1828mm x 1219mm) Max. - 3 hr. Horizontal: 72"w x 48"h (1828mm x 1219mm) Note: Due to continuing research, \*(May ship in Multiple Sections For Field Assembly) On Damper Height, See Chart UE reserves the right to change Features: specifications without notice. The F/S-3V-I or F/S-3V-3-I series Combination Fire/Smoke Dampers have been designed and tested to exceed all UL, ULC, and NFPA requirements for fire dampers as well as smoke dampers. **Options:** 16", Std F/S-3V-I is UL 555 and ULC S112 listed and labeled as an 1-1/2 hour rated fire damper. □ Factory sleeves \_ ga. (20 ga minimum). F/S-3V-3-I is UL 555 and ULC S112 listed and labeled as a Length inches (min. 16"). 3 hour rated fire damper. (16" x 20 ga side plate provided if no sleeve is indicated, Act. External) UL and ULC listed for both vertical and horizontal mountings. UL 555S /ULC S112.1 listed and labeled as a Class I rated ☐ Retaining Angles ☐ Smoke Detector Smoke Damper with airflow in both directions. Class I provides ☐ One Side □ Ionization for a max. leakage of 8 cfm/sq ft at 4.0" wg static pressure. ☐ Photoelectric ■ Both Sides □ DTO/RE w/ M/S Package Notes: □ Transitions Non-sleeved dampers with side plates are furnished approximately 1/4" ☐ M/S Blade Mounted end switch □ Round (6.4 mm) smaller than given duct dimensions. Sleeved dampers are ☐ Built in Actuator position End Switch □ Oval furnished approximately same size as given duct dimension unless Remote Control Boxes otherwise noted. RCB-1 RCB-2 RCB-3 RCB-4 Not recommended with blades running vertical. □ Actuator It is recommended the damper must be inspected and cycled at intervals □ Electric, not greater than every twelve months or in accordance with NFPA 80, vac (Voltage) 90A, 92A, local codes and the actuator manufacturer. Pneumatic, 25 psi Suggested Specifications: ☐ Grille Mtg. - 3/4" Mounted Face Flange Combination Fire/Smoke Dampers shall be model: F/S-3V-I or F/S-3V-3-I, by United ■ Shipped loose, 1" (if external actuator) Enertech. Fire/Smoke Dampers shall bear the Underwriters Laboratories labels for both Fire ■ Mounting Orientation Dampers and Smoke Dampers. UL 555S / ULC S112.1 ratings shall be Class I with leakage not to exceed 8 cfm per sq ft. at 4.0" static pressure for any size. Linkage shall be of the □ Vertical ☐ Horizontal concealed type for maximum free area.

Job Name.	☐ MODEL F/S-3V-1 (1-1/2 hour) ☐ MODEL F/S-3V-3-I (3 hour)		
Location:			
Architect:			
	DRAWN BY:	DATE:	REV. DATE:
Engineer:	GAB	11-12-07	2-11-20
	REV. NO.	APPROVED BY:	DWG. NO.:
Contractor:	8	CLJ	P-40



### MODEL F/S-3V-I & F/S-3V-3-I

## Combination Fire/Smoke Damper


UL 555 and ULC S112 Listed for 1-1/2 and 3 Hour Rated UL 555S and ULC S112.1 Listed Class I Leakage


#### **Performance Data**



United Enertech certifies that the F/S-3V-I is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Rating Seal applies to Air Performance ratings only.

Pressure drop test per AMCA Standard 500-D, Figure 5.3.

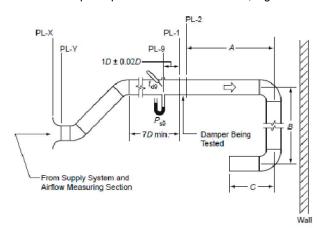

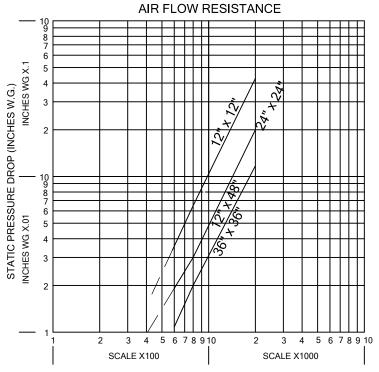

CD-110, 111 sizes: 12" x 12", 24" x 24", 48" x 12", 12" x 48", 36" x 36" (305 x 305mm, 610 x 610mm, 1219 x 305mm, 305 x 1219mm, 914 x 914mm)

Data corrected to standard air density

When the actuator is externally mounted and the wall thickness exceeds 5 inches, add 1 inch for each additional inch of wall thickness increased, to ensure sleeve extends through the penetration. As standard the actuator is externally installed on the lower right hand half of the damper when viewed from the jackshaft side. The damper may be installed or rotated 180° such that the actuator will be located on the upper left. The top of the damper is either side of the frame as long as the blades are running horizontal. When ordering internally mounted actuators, be aware there is a min. height requirement (in some cases the sleeve can be increased to allow for internal mounting). The entire damper frame does not have to be installed in the plane of the wall/floor. The rule of thumb is "with the damper in the closed position, the blade plane should be within the plane of the UL rated wall/floor".

