



CEILING RADIATION DAMPER WITH REGISTER BOX ASSEMBLY

MODEL CRD55-BT-6.0
MODEL CRD55-EA-BT-6.0

1 HOUR RATED CRD/REGISTER/GRILLE ASSEMBLY
CRD/REGISTER BOX ASSEMBLY FOR FLOOR/CEILING
AND ROOF/CEILING WOOD TRUSS ASSEMBLIES

UL DESIGN L-563, P-544

type
CRD
"ROUND"

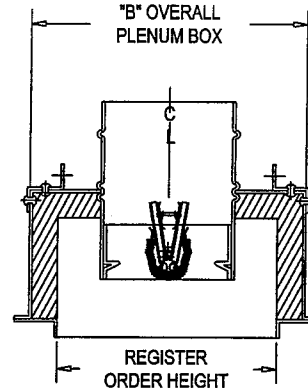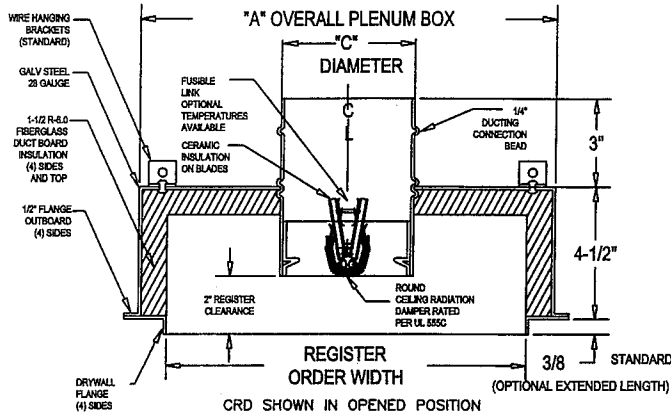

CEILING RADIATION DAMPER


1. UL LISTED FUSIBLE LINK (165°F STANDARD)(OPTIONS AVAILABLE)
2. BLADES 22 (.853mm) GA. GALV. STEEL
3. CERAMIC FIBER WITH FIBERGLASS COVER*
4. ROLL-FORMED ROUND FRAME 22 (.853 MM) GA. GALV. STEEL

PLENUM BOX

1. OUTER BOX: 28 GAUGE GALVANIZED STEEL
2. COLLAR: ROLL FORMED 28 GAUGE GALVANIZED STEEL WITH ROLL FORMED 1/4" BEADING.
3. INSULATION: FIBERGLASS DUCT BOARD 1-1/2" THICK (R-6.0)
4. "C" DIAMETER PROVIDED NOMINAL ORDER DIAMETER.

NOTES:

1. MINIMUM REGISTER SIZE 7" X 7" X 4" DIAMETER COLLAR
MAXIMUM REGISTER SIZE: 16" X 16" X 12" DIAMETER COLLAR
SEE THE CATALOG FOR FULL LISTING OF AVAILABLE STOCK SIZES.
FOR NON-STANDARD REGISTER SIZES CONSULT THE FACTORY.
2. AVAILABLE IN STAINLESS STEEL
3. AVAILABLE WITH EXTENDED LENGTH DRYWALL FLANGE
4. CRD55-EA-BT MINIMUM COLLAR DIAMETER 6".
5. REGISTER/GRILLE(STEEL) SUPPLIED BY OTHER.
- *6. CERAMIC INSULATION IS NOT REQUIRED ON DAMPERS WITH AREAS LESS THAN 80 SQUARE INCHES AND IS OPTIONAL.
DAMPERS ABOVE 80 SQUARE INCHES WILL BE PROVIDED WITH BLADE INSULATION.
7. MEETS UL263, NFPA 90A REQUIREMENTS

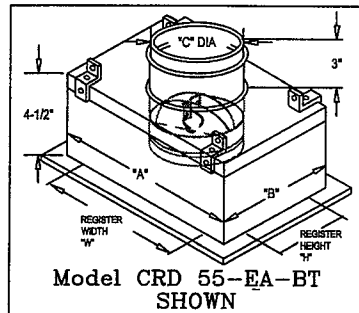

ORDERING: CRD 55EA-BT-6.0-10"W X 6"H X 6" DIA.



UL CLASSIFIED
SEE COMPLETE
MARKING ON PRODUCT

JOB NAME: _____


LOCATION: _____

ARCHITECT: _____

ENGINEER: _____

CONTRACTOR: _____

10357-REV-A-UL



LLOYD INDUSTRIES INC.

231 COMMERCE DRIVE
MONTGOMERYVILLE, PA. 18936
TEL: 215-412-4445
FAX: 215-412-4409
EMAIL: LLOYDIND@FIREDAMPER.COM

5858 BROADWAY AVE.
JACKSONVILLE, FL. 32254
TEL: 904-378-8440
FAX: 904-378-8441
EMAIL: LLOYDINDI@BELLSOUTH.NET

WEB SITE: FIREDAMPER.COM